

# **Electricity Markets Working Papers**

**WP-EM-29**

## **Germany's Wind Energy: The Potential for Fossil Capacity Replacement and Cost Saving**

Hannes Weigt

September 2008



Dresden University of Technology



Chair for Energy Economics and  
Public Sector Management

# Germany's Wind Energy: The Potential for Fossil Capacity Replacement and Cost Saving

Hannes Weigt

Corresponding author:

Hannes Weigt

Dresden University of Technology

Faculty of Business and Economics

Chair of Energy Economics and Public Sector Management

01069 Dresden, Germany

Phone: +49-(0)351-463-39764

Fax: +49-(0)351-463-39763

hannes.weigt@tu-dresden.de

Abstract:

Wind energy has become the major renewable energy source in Germany with an installed capacity of more than 20 GW and an annual output of about 40 TWh in 2007. In this paper we analyze the extent to which wind energy can replace fossil capacities based on wind injection and demand data for 2006 through June 2008. The results indicate that the wind potential in Germany will not allow a significant reduction of fossil capacities. We also assess the potential savings due to wind energy. The German market is modeled with and without wind input to estimate the net savings of fossil fuels in the observation period. We find that the cost-saving potential for electricity production is quite significant in the study period and exceeds the subsidies.

Key words: electricity, wind energy, reserve, cost saving, Germany

JEL-code: L94, L51, D61

# 1 Introduction

The fostering of renewable energy sources in electricity markets has led to significant utilization of wind energy. In Europe about 56 GW of wind was installed by the end of 2007, doubling the capacity within the last 5 years (EWEA, 2008). Germany in particular has seen a sharp rise in the use of wind. However, the European grid, which was never designed to cope with large-scale fluctuations in generation, now requires extensive upgrading, e.g., major investments in transmission (see Dena, 2005).

Germany's Transmission System Operators (TSOs) are obligated to publish hourly projected wind generation. Therefore, since late 2005 an adequate database exists that allows researchers to conduct empirical analyses of recent developments. Since wind energy is "free", each MWh that replaces fossil energy saves on fuel costs. Yet obstacles exist that limit wind's utilization with respect to reserve capacity, operational back-up, wind speed forecasts, planning/siting offshore parks, network extensions, voltage and reactive power support, and impacts upon emissions and market prices. This paper focuses on reserve capacity and wind's impact upon generation costs and market prices.

The issue of reserve capacity can be divided into short- and long-term analyses.

In the short-term actual dispatch and management of fluctuating output in a given market environment is studied, including network and generation issues. Østergaard (2002) analyzes the impact of renewable energy production for Denmark's transmission grid in 2020. He shows that unless a geographically scattered balancing mechanism is applied, the network needs reinforcement to cope with transmission demand. Lund and Münster (2003) analyze the management of surplus energy from fluctuating sources in Denmark, and conclude that additional network investments can be avoided by adapting the generation side and building a more flexible energy system including heat pumps, storage, and the regulation of CHP plants. Lund (2005) extends the analysis by looking at integrating large-scale wind energy outputs into different energy and regulatory systems. The systems include large CHP shares, electrified road transport, and fuel cell technologies. Luickx et al. (2008) take up the question of operational backup for wind integration. They apply an MILP model to test two methods for providing backup: a 100% provision of additional spinning reserves and balancing wind with all other units by the TSO. Whereas both methods show a cost increase due to increased wind power, none has a clear advantage once the underlying parameters (wind profile, load profile, and installed capacity) are changed.

In the long-term the impact of wind energy on the optimal power plant mix is analyzed. Since wind speeds fluctuate over time, installed capacity and actual output can vary quite drastically. Thus a one-to-one replacement of conventional power plants by wind turbines is improbable. However, it may be possible that with increased installed capacities in a sufficiently large geographic area, either a minimum wind output or a secured peak load reduction can be achieved. This gain in capacity reduction due to additional wind energy is often termed capacity credit. Strbac et al. (2007) analyze the impact of wind energy on the UK electricity market. Although they conclude that the system will

be able to accommodate large increases of wind generation, the actual capacity credit is rather low. To secure the same level of supply security, large, conventional backup capacities are needed that only have low load factors, but will likely drive market prices. Further, they note that wind's capacity credit drops with the level of penetration. Oswald et al. (2008) analyze whether wind conditions in the UK provide enough reliable supply. Based on a model of distributed wind generation in the UK they conclude that the geographically aggregated output flattens the output of wind energy but still retains significant levels of volatility. Wind output in the hours of peak load can be low and the same is true for the inclusion of neighboring countries. Power swings may increase the need for conventional plants to undergo frequent load shifts. Østergaard (2008) analyzes the aggregation of wind turbines in different regions of Denmark. He concludes that it reduces the need for operational reserve capacity. However, the same is not true for the maximum capacity reserve needed in the modeled area because there are times with zero wind output in all regions. Giebel (2005) provides a summary of studies on wind's capacity credit. All of the included studies state that wind power indeed has a capacity credit, but that it strongly depends on the underlying electric system and wind's load factors and penetration level. In general, systems with little wind penetration show a higher credit around the mean wind power output, while for large penetrations the credit drops to 10-15%.

Questions about social costs, cost saving, and external costs also merit attention especially because most wind energy is subsidized. Two effects of wind energy have an impact on market prices: first, the replacement of fossil power plant output by wind capacities shifts the demand level to the left and thus lowers the market prices and the needed generation costs; second, the reduced output of fossil plants lowers overall emissions and may also lower the allowance price that in turn has a decreasing impact on market prices. De Miera et al. (2008) analyze the impact of increased wind energy on wholesale market prices for Spain. By applying a simulation analysis of the dispatch in the Spanish market they show a negative correlation between wind electricity promotion and wholesale market prices. In their observation period from 2005 until 2007 average price reductions of 9-25% can be achieved. Bode (2006) conducts a numerical analysis of the impact of wind generation on German market prices. By applying different demand curve assumptions as well as different feed-in tariffs he concludes that wind's net benefit may be positive or negative. A further analysis of the price-reducing effect of wind energy has been issued by the German Federal Environment Ministry (Sensfuß et al., 2008). By applying a detailed market model the authors conclude that the merit order effect of wind generation led to a price reduction of about 8 €/MWh and total costs saving of about 5 billion € in 2006.

Rathmann (2007) analyzes the impact of wind energy on emission allowance prices and its feedback on market prices, concluding that in the presence of an emission trading scheme additional wind generation can reduce allowance prices (and thus electricity prices). For the first trading period between 2005 and 2007 he estimates a reduction of electricity prices by 6.4 €/MWh for Germany solely by reduced emission prices not taking into account price impacts due to a changed dispatch. Compared to the increase in electricity prices of 3.8 €/MWh from the feed-in tariffs, a net benefit of wind generation is obtained. Rosen et al. (2007) apply long- and short-term models to estimate the

effects of large-scale wind generation in Germany. They show that wind energy substitutes for mainly base-load capacities like coal and nuclear whereas gas-fired plants are needed to cope with the fluctuation of wind output. Bocard (2008) estimates the social costs of wind power for countries including Germany, Denmark, Spain, and Ireland by analyzing their electric systems in a standardized setting with and without wind input.

The objective of this paper is to analyze the available information regarding wind energy output in Germany from 2006 until June 2008. Given the hourly wind input data two questions are asked.

First, how much fossil capacity can be replaced by the installed wind turbines? Given the high fluctuation in wind speeds, wind capacities are not dispatchable like conventional power plants. However, if a large area is covered by wind parks, differences in local wind availability may partly “flatten” the fluctuation and therefore decrease the need for fossil backup. The question is answered by analyzing wind and load profiles and assessing the potential for capacity replacement.

Second, how much has the injected wind energy saved in terms of fossil fuel costs? On one hand, wind energy reduces the load levels of operating plants, saving fuel costs, lowering the demand levels, and bringing down market prices. On the other, the fluctuating wind input can also increase plant ramp ups/downs and thus raise generation costs. This question is analyzed using a market model to compare prices and generation costs of the actual wind and demand levels in the observation period with a “wind free” case.

The remainder of the paper is structured as follows: Section 2 presents the dataset and the analysis methodology. Section 3 presents the results for the capacity and cost analysis. Section 4 concludes.

## **2 Dataset and analysis methodology**

### **2.1 Wind energy output in Germany**

To test the availability of wind energy within Germany the hourly wind feed-in during the period from 2006 till summer 2008 is obtained from the four German TSOs. The total output of wind parks was about 30 TWh in 2006, about 40 TWh in 2007, and about 22 TWh in the first half of 2008. Compared to the total demand for electricity in Germany of more than 600 TWh wind energy still plays only a minor role. However, installed wind capacities comprise a large share of the available generation capacity. During the observation period the installed capacity increased from 18.5 GW to 23.4 GW putting it on a level playing field with nuclear and coal. To obtain an hourly input in relation to the available wind capacity the half yearly capacity values published by DEWI are linearly interpolated.

The geographic area covered by wind facilities extends from the North Sea coastline to sites in the South. Table 1 gives a summary of the installed wind capacities in each federal state. One can observe a clear distinction between the North (large amounts installed) and the South (less capacity).<sup>1</sup> The demand level is obtained from UCTE (2008) to assess the impact of wind energy on the load level.

The dataset is divided in time-of-day subsets: base (0am-12pm), off-peak (8pm-8am), mid load (8am-8pm), noon (11am-1pm), and evening (5pm-7pm).

**Table 1: Installed wind capacities in Germany**

Federal State	Installed Capacities, end of 2005 [MW]	Installed Capacities, end of 2006 [MW]	Installed Capacities, end of 2007 [MW]
Baden-Württemberg	263	325	404
Bavaria	258	339	387
Berlin	0	0	0
Brandenburg	2620	3128	3359
Bremen	52	64	72
Hamburg	34	34	34
Hesse	426	450	476
Mecklenburg-Western P.	1095	1233	1327
Lower Saxony	4905	5283	5647
North Rhine-Westphalia	2226	2392	2558
Rhineland-Palatinate	810	992	1122
Saarland	57	57	69
Saxony	703	769	808
Saxony-Anhalt	2201	2533	2786
Schleswig-Holstein	2275	2391	2522
Thuringia	502	632	677

Source: DEWI (2006, 2007, 2008)

## 2.2 Estimating the capacity credit

Basically, wind energy can reduce the need for fossil capacity within an electricity market in two ways. First, the geographical and meteorological differences within the market area can lead to a steady minimum wind energy level similar to a base load plant. In order to test this effect for different plant types the hourly input data is divided into subsets and wind profiles are conducted, ordering the input from the highest to the lowest value. First the off-peak segment and thus potential replacement of base load plants (i.e. nuclear or coal) is tested. Second, potential replacement of mid-load plants is estimated. Finally the peak segment is analyzed.

Second, is by shifting the load curve which in turn reduces peak load. Whereas the fluctuating nature of wind may lead to zero/almost no wind input in some hours of a year, the demand reduction may be achieved with a higher probability. Necessary peak capacity is defined by a few hours in the year and already a low wind output can bring those values down. To test this effect the load duration curve for Germany is compared to an adjusted duration curve reduced by the hourly wind input. The difference of the peak value represents the potential for capacity reduction. The analysis is carried out for different time segments.

The capacity reduction analysis is based on the available information in the observation period (this paper neglects model tests or extrapolation to future scenarios) and the results only give a historical

---

<sup>1</sup> By the end of 2007 about 18.3 GW were installed in the Northern states and only 3.9 GW in the Southern states. This divergence will increase with the projected extension of offshore capacities.

review. Nevertheless, given the sample size of more than 20,000 hours, the data is assumed to provide reasonable estimates.

### 2.3 Market model for cost analysis

Based on the wind output data a market model is constructed to estimate the differences in production costs and market prices caused by wind penetration. The model is designed to minimize costs, including unit commitment and start-up costs:

$$\min \text{ costs} = \sum_{t,p} (c_p^t g_p^t) + \sum_{t,p} \text{startup}_p^t \quad \text{objective} \quad (1)$$

$$on_p^t g_p^{\min} \leq g_p^t \leq on_p^t g_p^{\max} \quad \text{capacity constraint} \quad (2)$$

$$d^t = \sum_p g_p^t \quad \text{energy balance} \quad (3)$$

The market is characterized by a set of plants  $p$  with constant marginal costs  $c_p$  and it is assumed to be perfectly competitive. Demand  $d$  is externally given (equation 3) and the objective is to satisfy this demand in a least-cost manner (equation 1). The plants are subject to capacity constraints (equation 2) giving an upper bound on generation  $g^{\max}$  and a lower bound  $g^{\min}$  when the plant is online ( $on_p=1$ ). The plant commitment includes constraints on the start-up time and the associated start-up costs. Pumped storage plants are included to allow for more flexible dispatch.<sup>2</sup> The model is solved for a set of hours  $t$  covering the entire observation period.

The dataset for the power plant park is based on VGE (2005, 2006) and includes all conventional facilities in Germany with more than 100 MW generation capacity by plant and fuel types. Seasonal availability factors are taken from Hoster (1996). An efficiency value for each plant is estimated based on the construction year following Schröter (2004). The efficiency value is also used to obtain plant-specific CO<sub>2</sub> emissions (Gampe, 2004). Fuel prices for oil, gas, and coal are taken from the Federal Office of Economics and Export Control (BAFA) and vary for each month. Emission Allowance (EUA) prices are taken from the EEX and, like fuel prices, are averaged for each month.

The model is calculated for two different demand sets. First, the demand values published by the UCTE are run. They represent the benchmark case with no wind input. In a second run the demand values are reduced by the hourly wind input values, lowering the demand conventional plants have to satisfy. The difference between both model runs can be seen as the savings from wind energy.

Although the model is a detailed representation of the German market, model assumptions and simplifications bias the results. The model is static with respect to the underlying parameters. Excluding wind energy in the market would increase the output of conventional plants which in turn affects the EUA price. Import/export of electricity is not considered and therefore the impact of higher

prices regarding the replacement of German generation by foreign imports is neglected. In addition imports and exports alter the demand level; since Germany is on average an exporting country, the demand level is on average too low. The model does not consider small-scale generation by solar, biomass, and other distributed generators which in turn leads to an overestimation of the demand level on average and may offset the export error. Nevertheless, the obtained cost and price values give a more sophisticated approximation than pure average cost calculations or simple, stylized market models.

## 3 Results and discussion

### 3.1 Capacity credit

First, the potential for capacity replacement is analyzed. Given the wind output curves for each load segment it is clear that nearly all wind capacity must be backed up (see Figure 3 in the Appendix). The aggregated output of all wind turbines in Germany dropped below 10% of the installed capacity in about 40% of the observed hours independent of the time-of-day segment. The actual guaranteed feed-in during the observation period was less than 0.5%. We conclude that Germany appears to provide a rather limited wind divergence with respect to the current locales of wind turbines.

Second, wind's impact on the load profile is estimated. Figure 1 shows the full load duration curve during the observation period. We observe a parallel shift of the overall load level by about 5 GW due to wind output.<sup>3</sup> During the night there is a saving in peak capacity requirements of 3.5 GW, during the day 4.6 GW, and during the noon peak the saving even reaches 5.7 GW. Thus within the observation period about 3 GW of base- load capacity and additionally 1 GW of mid- or peak-load plants could have been replaced by the 20 GW of wind turbines due to load reduction. This number resembles the 10-15% capacity credit for large systems given in Giebel (2005). However, due to the stochastic nature of wind speeds the observed numbers do not represent guaranteed values. Looking at the distribution of wind energy output during peak hours in the winter months shows that the observed values can not be taken for granted in the future because in each hour the wind input dropped below 1% of installed capacity (Table 2).<sup>4</sup>

The available data for Germany does not encourage drawing the conclusion that the installed wind capacities allow a significant reduction of installed conventional capacities. In order to guarantee a secure supply of electricity in all possible load cases nearly the full wind capacity must be backed up. However, the reserve capacities will face a largely reduced running time. Additional measures such as demand side management combined with locational prices, active wind park management, extension of cross- border capacities, and promoting European electricity trading may increase the benefits from

---


<sup>2</sup> A more detailed description of the model is provided in Weigt and Hirschhausen (2008).

<sup>3</sup> The two duration curves are ordered separately from the lowest to the highest value.

<sup>4</sup> The selected hours are most likely to define the yearly peak load and thus the necessary generation capacity.

large-scale wind integration. Too, the capacity credit of wind energy may increase if the geographic scope is extended beyond Germany (see Østergaard, 2008).

**Figure 1: Load duration curve with and without wind energy, 2006 until June 2008**

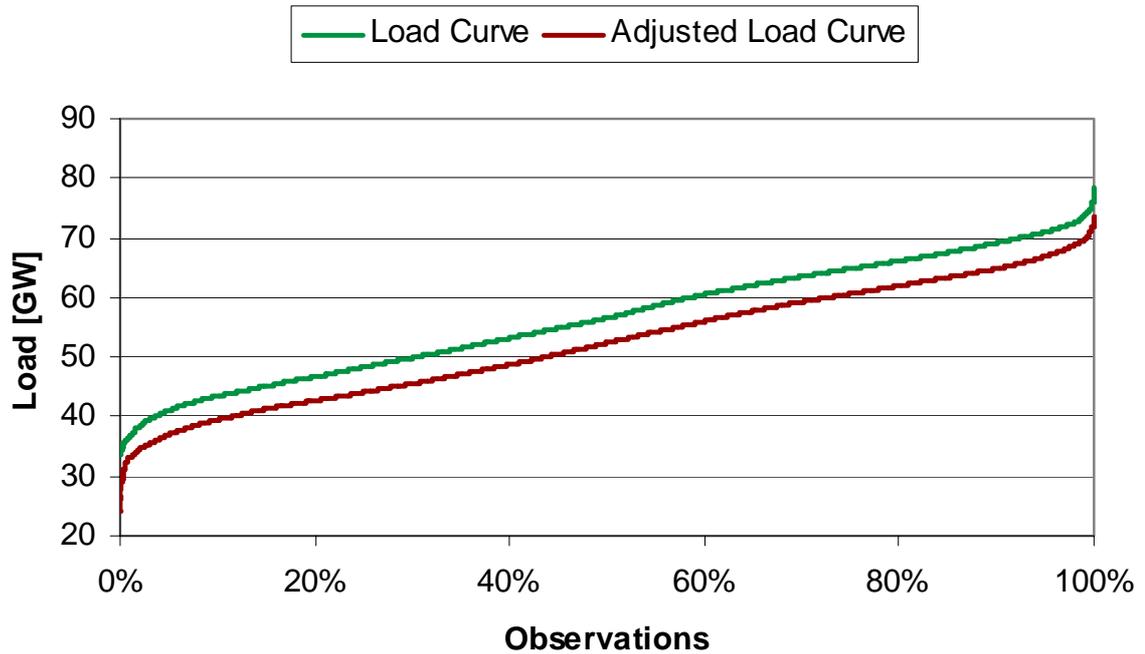

**Table 2: Availability of wind energy (in % of installed capacity)**

Hour:	11am	12am	1pm	5pm	6pm	7pm
<b>Max</b>	84.7%	83.1%	81.7%	84.2%	83.5%	82.0%
<b>Min</b>	0.6%	0.7%	0.7%	0.6%	0.7%	0.7%
<b>Mean</b>	27.5%	28.0%	28.6%	28.0%	27.8%	27.9%
<b>Median</b>	23.4%	23.6%	24.8%	22.6%	22.5%	22.7%

### 3.2 Cost saving

Table 3 summarizes the obtained results for each year from analyzing cost saving.<sup>5</sup> As expected wind generation has a decreasing impact on both prices and generation costs. On average a price reduction of about 10 €/MWh is obtained during the observation period. However, the impact varies for different hours (and different load levels). Whereas during off-peak hours the impact of increased wind generation is rather small there is a significant reduction during peak hours (Figure 2). This can be explained by the impact of wind generation on the merit curve of electricity markets. Electricity markets typically face a relatively flat supply curve in the beginning and a rapid slope increase in peak load levels. Given that wind has no fuel costs it is added at the left side of the merit order curve, shifting the whole curve to the right. During off-peak times this shift has little price impact due to the flat gradient. However, during peak times even a small shift can cause significant price differences.


As expected the overall generation costs decrease with increased wind generation as more costly fossil production is replaced by free wind energy. During the observation period a total saving of 4.1 billion

<sup>5</sup> A seasonal break down of the results is presented in the Annex (Table 4).

€ is obtained (1.3 bn in 2006, 1.5 bn in 2007, and 1.3 bn in the first half of 2008). The significant increase in 2008 can be explained by the re-increase of the emission allowance prices for 2008. Although those prices dropped to nearly zero during 2007, they are levelized at about 20 €EUA in 2008. Start-up cost also decreased with wind generation by about 20 million € in the observation period. However, this result appears to depend on the actual wind feed-in pattern since there are seasons with increased start-up costs and seasons with decreases (see Table 4 in the Appendix). Further, the model is a deterministic optimization and thus the wind feed-in is known when determining the unit commitment, leading to an optimal allocation that is not obtainable in real markets. Ramping constrictions and the impact of partial load on plant efficiencies is not part of the model and so the resulting impact on start-up costs is likely to be underestimated.

Comparing the gains of wind energy with the additional expenses consumers assume due to the feed-in tariffs still shows a small net benefit. The total reimbursement for wind energy in 2007 is 3.5 billion € (BMU, 2008). Given an electricity demand in Germany of about 500 TWh this leads to a price increase of 7 €/MWh.<sup>6</sup> This puts the savings from reduced market prices in roughly the same range as the additional expenses due to the feed-in tariffs. Adding the possible savings from the reduction in emission allowance prices (see Rathmann, 2007) indicates that the overall impact of wind energy on consumer prices is positive.<sup>7</sup> Beside the pure market price effect, there is the saving in fuel costs of more than 1 billion € per year (given the current fuel prices), another benefit of wind energy that improves its overall balance.

**Figure 2: Average market prices in Germany, 2006 until June 2008**

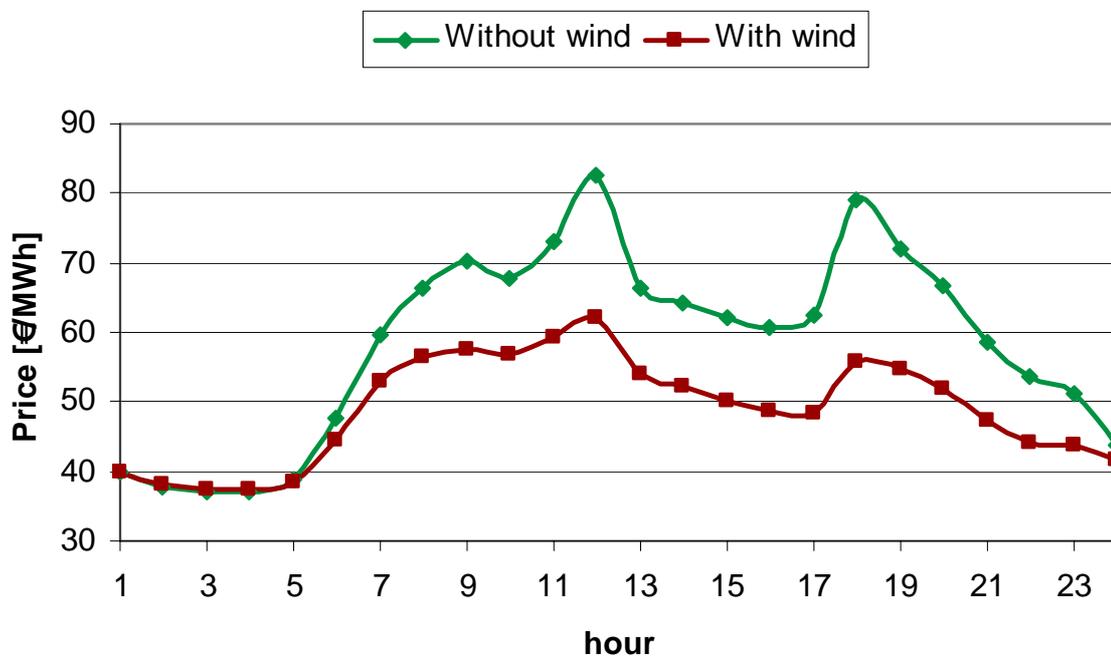

<sup>6</sup> The numbers for 2006 are lower because less wind energy has been injected. Numbers for 2008 are not yet available but are assumed to be slightly higher given the additional installed wind capacity.

**Table 3: Model results**

		2006	2007	First half of 2008
<b>Without Wind</b>	Fuel costs [bn €]	14.4	11.4	9.5
	Start-up costs [mn €]	111.3	133.4	68.3
	Peak price [€/MWh]	66.36	63.27	85.56
	Off-peak price [€/MWh]	48.20	38.90	63.57
	Average price [€/MWh]	57.28	51.09	74.57
<b>With Wind</b>	Fuel costs [bn €]	13.1	9.9	8.2
	Start-up costs [mn €]	103.8	117.7	72.8
	Peak price [€/MWh]	56.26	46.44	66.19
	Off-peak price [€/MWh]	45.78	34.80	56.68
	Average price [€/MWh]	51.02	40.62	61.44

## 4 Conclusion

In this paper the available hourly wind generation data for 2006 until June 2008 published by the four German TSOs is empirically analysed to assess the potential of wind energy to replace installed conventional generation capacities and to reduce generation costs. The existing data does not provide evidence for a significant capacity credit of wind energy in Germany. Although during the observation period a reduction of peak load levels of about 4 GW is observed the variance of wind input does not guarantee this reduction. An aggregation of the geographic area including Denmark, the Benelux, and Poland may increase the potential of wind generation to replace installed conventional capacity.

The cost saving potential of wind energy is quite significant in the observation period. On average the generation costs decreased by more than 1 bn € per year due to the availability of wind energy. Wind generation also leads to a significantly lower market price particularly during peak periods. The average electricity price is about 10 €/MWh lower in Germany in the observation period. Compared to the increase of consumer prices from the renewable support mechanism of 7 €/MWh there still is a net benefit of wind energy of 3 €/MWh, not accounting for possible additional gains of reduced emission allowance prices.

## References

- Boccard, Nicolas (2008): *The Social Cost of Wind Power*. Presented at: Conference on “The Economics of Energy Markets”, Toulouse, France, June 20-21, 2008.
- Bode, Sven (2006): *On the impact of renewable energy support schemes on power prices*. Hamburg, Hamburg Institute of International Economics (HWWI), HWWI Research Programme International Climate Policy, 4-7.

---

<sup>7</sup> However, one should acknowledge the shortcoming of the model and thus a possible result bias. The short-term nature does not account for price impacts due to changes in the power plant investment pattern and a possible under- utilization of those plants that must provide backup for wind generation.

- BMU (2008): *Beschaffungsmehrkosten für Stromlieferanten durch das Erneuerbare-Energien-Gesetz im Jahr 2007 (Differenzkosten nach § 15 EEG)*. Report for the German Federal Environment Ministry.
- DENA (2005): *dena-Netzstudie, Energiewirtschaftliche Planung für die Netzintegration von Windenergie in Deutschland an Land und Offshore bis zum Jahr 2020*. Deutsche Energie-Agentur.
- DEWI (2006): Status 31.12.2005, German Wind Energy Institute (DEWI).
- DEWI (2007): Status 31.12.2006, German Wind Energy Institute (DEWI).
- DEWI (2008): Status 31.12.2007, German Wind Energy Institute (DEWI).
- Gampe, Uwe (2004): *Umweltaspekte von Energieanlagen*. Institut für Energietechnik, Technische Universität Dresden, Vorlesungsunterlagen.
- Giebel, Gregor (2005): *Wind Power has a Capacity Credit A Catalogue of 50+ Supporting Studies*. Risø National Laboratory, Report.
- Hoogwijk, Monique, Detlef Van Vuuren, et al. (2007): Exploring the impact on cost and electricity production of high penetration levels of intermittent electricity in OECD Europe and the USA, results for wind energy. In: *Energy*, Vol.32, No.8, pp. 1381-1402.
- Hoster, Frank (1996): *Auswirkungen des europäischen Binnenmarktes für Energie auf die deutsche Elektrizitätswirtschaft*. Oldenbourg, München.
- Luickx, Patrick J., Erik D. Delarue, and William D. D'haeseleer (2008): Considerations on the backup of wind power: Operational backup. In: *Applied Energy*, Vol.85, No.9, pp. 787-799.
- Lund, Henrik, and E. Münster (2003): Management of surplus electricity-production from a fluctuating renewable-energy source. In: *Applied Energy*, Vol.76, No.1-3, pp. 65-74.
- Lund, Henrik (2005): Large-scale integration of wind power into different energy systems. In: *Energy*, Vol.30, No.13, pp. 2402-2412.
- Miera, Gonzalo Sáenz De, Pablo Del Río González, and Ignacio Vizcaíno (2008): Analysing the impact of renewable electricity support schemes on power prices: The case of wind electricity in Spain. In: *Energy Policy*, Vol.36, No.9, pp. 3345-3359.
- Østergaard, Poul Alberg (2003): Transmission-grid requirements with scattered and fluctuating renewable electricity-sources. In: *Applied Energy*, Vol.76, No.1-3, pp. 247-255.
- Østergaard, Poul Alberg (2008): Geographic aggregation and wind power output variance in Denmark. In: *Energy*, Vol.33, No.9, pp. 1453-1460.
- Oswald, James, Mike Raine, and Hezlin Ashraf-Ball (2008): Will British weather provide reliable electricity? In: *Energy Policy*, Vol.36, No.8, pp. 3212-3225.
- Rathmann, M. (2007): Do support systems for RES-E reduce EU-ETS-driven electricity prices? In: *Energy Policy*, Vol.35, No.1, pp. 342-349.
- Rosen, Johannes, Ingela Tietze-Stöckinger, and Otto Rentz (2007): Model-based analysis of effects from large-scale wind power production. In: *Energy*, Vol.32, No.4, pp. 575-583.

Schröter, Jochen (2004): *Auswirkungen des europäischen Emissionshandelssystems auf den Kraftwerkseinsatz in Deutschland*. Diplomarbeit, Berlin University of Technology, Institute of Power Engineering.

Sensfuß Frank, Mario Ragwitz, and Massimo Genoese (2007): *The merit-order effect: A detailed analysis of the price effect of renewable electricity generation on spot market prices in Germany*. In: *Energy Policy*, Vol. 36, No. 8, pp 3086-3094.

Strbac, Goran, Anser Shakoor, Mary Black, et al. (2007): Impact of wind generation on the operation and development of the UK electricity systems. In: *Electric Power Systems Research*, Vol.77, No.9, pp. 1214-1277.

UCTE (2008): <http://www.ucte.org/services/onlinedatabase/consumption/>, retrieved 18.08.2008.


VGE (2005): *Yearbook of the European Energy and Raw Materials Industry 2005*. Essen,Verlag Glückauf GmbH.

VGE (2006): *Yearbook of the European Energy and Raw Materials Industry 2006*. Essen,Verlag Glückauf GmbH.

Weigt, Hannes, and Christian von Hirschhausen (2007): Price Formation and Market Power in the German Wholesale Electricity Market in 2006. In: *Energy Policy* (forthcoming).

## Annex

Figure 3: Wind output curves for Germany, 2006 until June2008

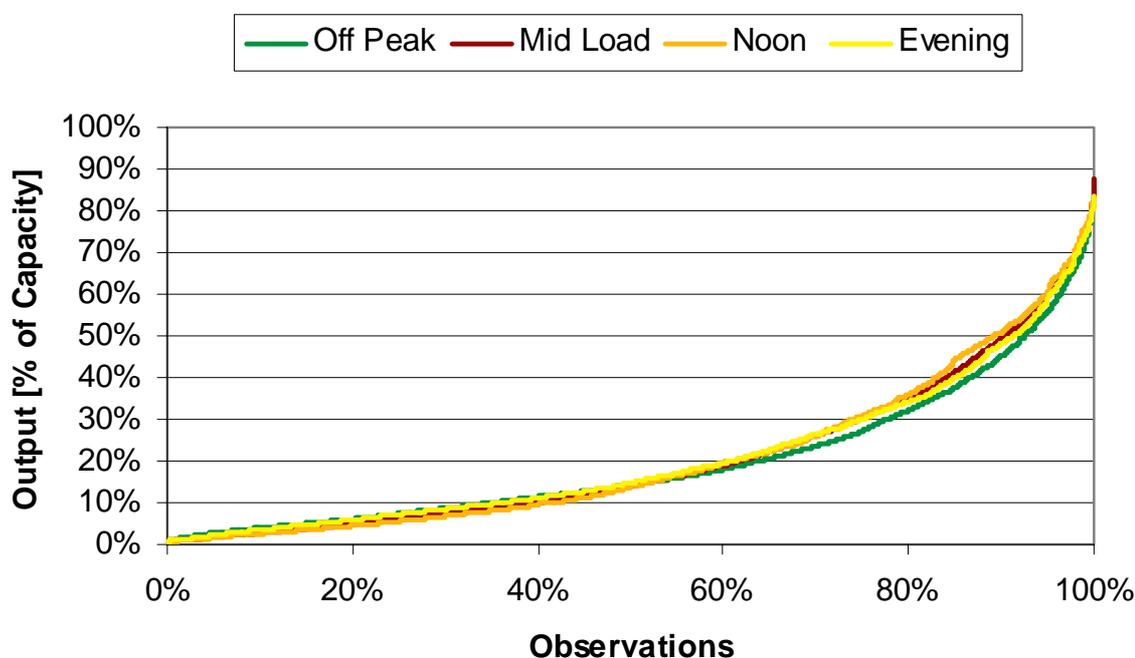

**Table 4: Cost analysis and overview of results<sup>8</sup>**

		Winter 2006	Spring 2006	Summer 2006	Fall 2006
Without Wind	Fuel costs [mn €]	4023.6	3950.1	3153.6	3255.3
	Start-up costs [mn €]	26.1	23.8	23.4	38.1
	Peak price [€/MWh]	63.5	65.9 €	67.9 €	68.1 €
	Off-peak price [€/MWh]	47.8	53.1	48.2	43.6
	Average price [€/MWh]	55.6	59.5	58.1	55.8
With Wind	Fuel costs [mn €]	3642.7	3574.4	2975.3	2862.7
	Start-up costs [mn €]	24.2	26.4	23.8	29.4
	Peak price [€/MWh]	53.1	55.7	61.1	55.0
	Off-peak price [€/MWh]	44.9	50.1	46.6	41.4
	Average price [€/MWh]	49.0	52.9	53.9	48.2
		Winter 2007	Spring 2007	Summer 2007	Fall 2007
Without Wind	Fuel costs [mn €]	4006.8	2311.2	2288.7	2776.5
	Start-up costs [mn €]	27.4	26.0	29.8	50.2
	Peak price [€/MWh]	65.5	44.1	62.5	81.2
	Off-peak price [€/MWh]	48.0	29.7	36.1	42.1
	Average price [€/MWh]	56.8	36.9	49.3	61.6
With Wind	Fuel costs [mn €]	3328.6	2058.3	2070.1	2426.2
	Start-up costs [mn €]	27.7	27.6	26.3	36.1
	Peak price [€/MWh]	53.6	29.5	43.2	59.8
	Off-peak price [€/MWh]	46.0	25.1	28.1	40.3
	Average price [€/MWh]	49.8	27.3	35.7	50.1
		Winter 2008 <sup>9</sup>	Spring 2008	Summer 2008 <sup>10</sup>	
Without Wind	Fuel costs [mn €]	3211.6	4688.4	1567.3	
	Start-up costs [mn €]	23.2	34.6	10.6	
	Peak price [€/MWh]	83.7	81.6	101.5	
	Off-peak price [€/MWh]	61.9	62.3	70.7	
	Average price [€/MWh]	72.8	72.0	86.1	
With Wind	Fuel costs [mn €]	2621.4	4138.8	1427.0	
	Start-up costs [mn €]	27.0	35.9	10.0	
	Peak price [€/MWh]	60.0	64.7	82.8	
	Off-peak price [€/MWh]	53.2	56.6	63.6	
	Average price [€/MWh]	56.6	60.7	73.2	

<sup>8</sup> Winter is defined as January, February, and December; Spring as March, April, and May, Summer as June, July, and August; Fall as September, October, November.

<sup>9</sup> Winter 2008 only consists of January and February.

<sup>10</sup> Summer 2008 only consists of June.